


NOTES

1. USE READY-MIX CONCRETE WITH 3,000 PSI STRENGTH @ 28 DAYS.
2. SEE STANDARD PRECAST MANHOLE DETAIL FOR TOP SECTION OF MANHOLE.

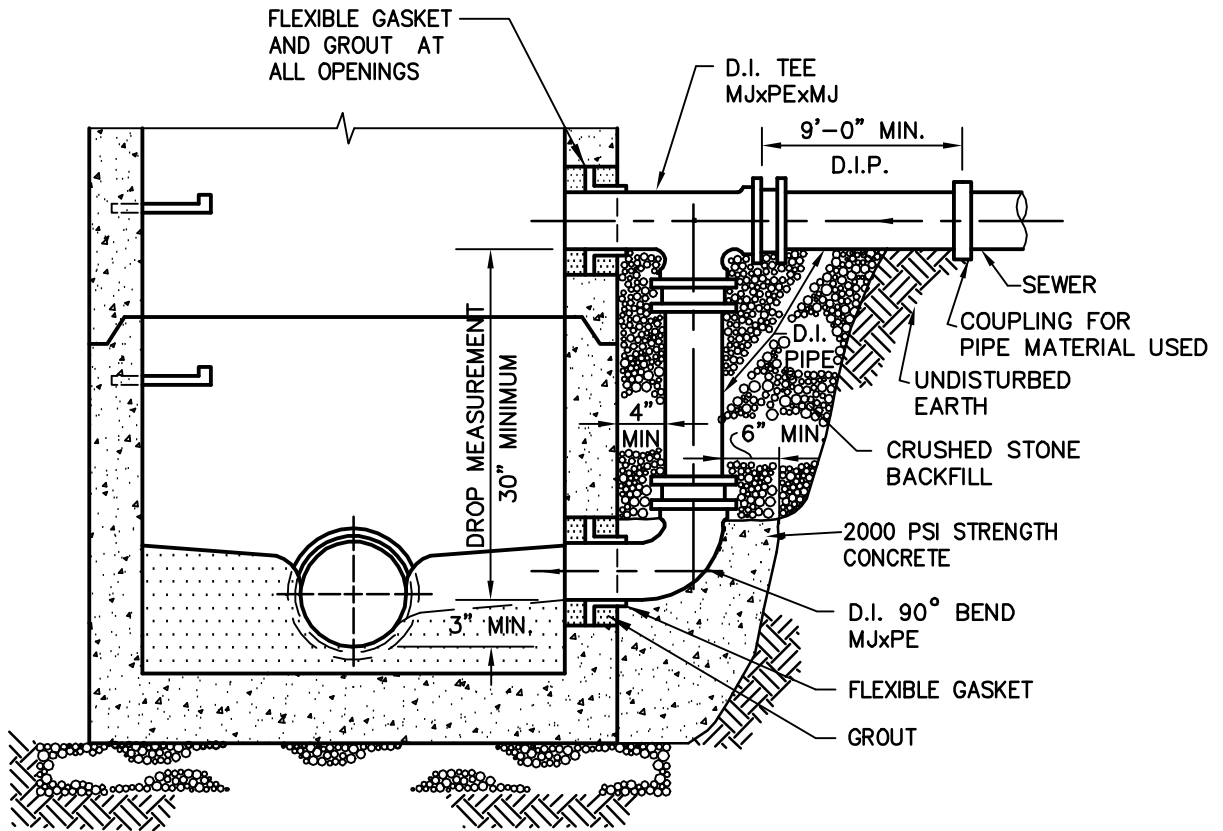

2	12/20/03	DLJ	REVISED MINIMUM DIMENSION.
1	10-2-97	DJH	DELETED SCHEDULE
NO.	DATE	BY	REVISION

BARTOW COUNTY, GEORGIA
 BARTOW COUNTY WATER SYSTEM
 TELEPHONE (770) 387-5170

**SEWER DETAILS
 DROP CONNECTION**

DRAWN BY: DJH	SCALE: NTS	DATE: NOVEMBER 15, 1996	DWG. NO.: SEW-4
---------------	------------	-------------------------	-----------------