


**NOTES**

1. INSTALL CASING BY BORING AND JACKING, UNLESS OTHERWISE NOTED.
2. CARRIER PIPE IN CASING SHALL BE DUCTILE IRON PIPE, PUSH-ON JOINTS WITH RESTRAINED JOINTS, U.S. PIPE FIELD LOK OR EQUAL.

DUCTILE IRON CARRIER PIPE		STEEL CASING PIPE	
INSIDE DIA.	MAX. BELL O.D.	NOMINAL DIA.	WALL THICK.
6"	9"	12"	0.250"
8"	11 1/4"	16"	0.375"
10"	13 1/2"	18"	0.375"
12"	15 1/2"	20"	0.375"
16"	20"	24"	0.375"
18"	22 1/4"	30"	0.500"
20"	24 1/4"	30"	0.500"
24"	28 1/2"	36"	0.500"

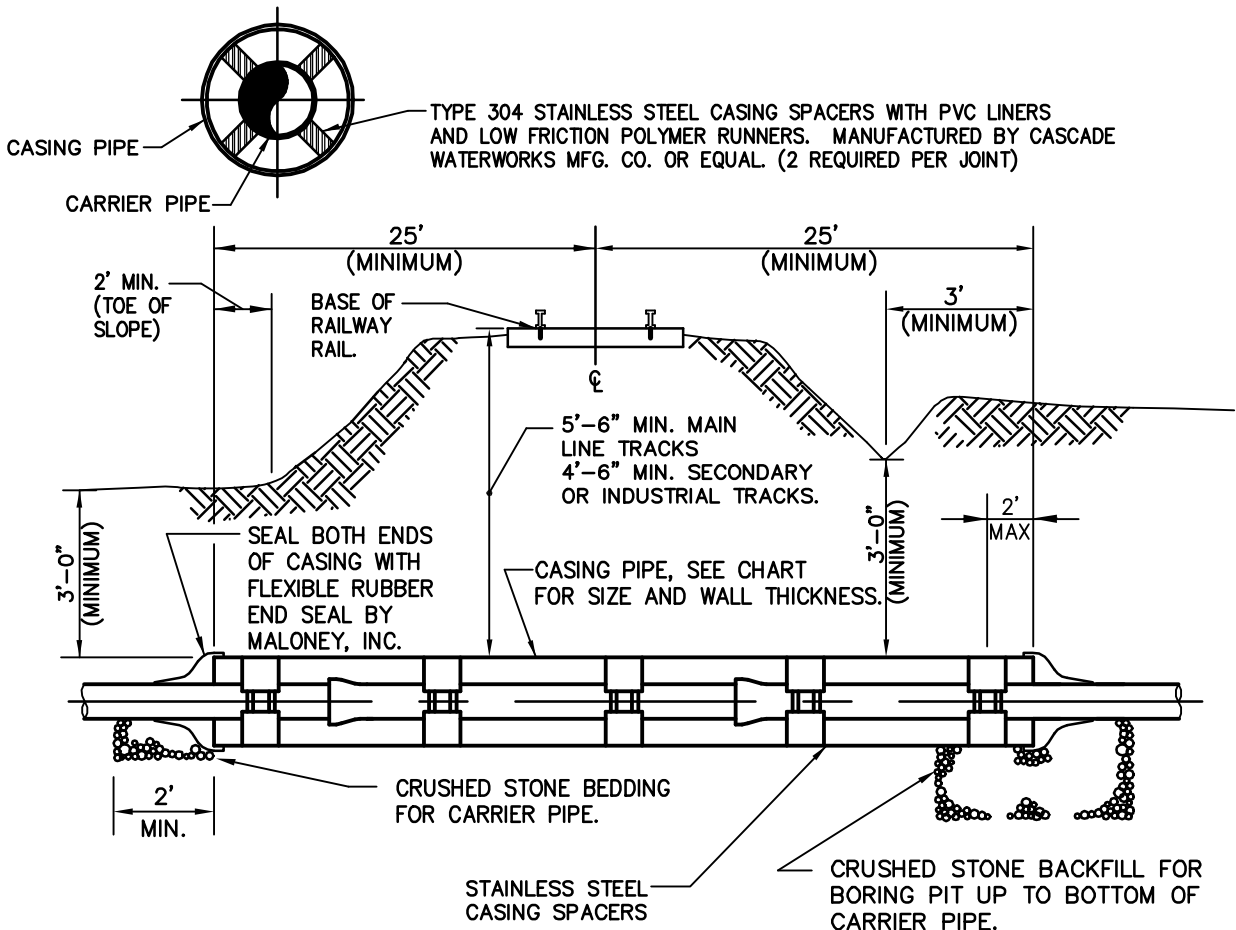

1	12/20/03	DLJ	REVISED NOTES
NO.	DATE	BY	REVISION

**BARTOW COUNTY, GEORGIA**  
 BARTOW COUNTY WATER SYSTEM  
 TELEPHONE (770) 387-5170

**WATER & SEWER DETAILS  
 RAILROAD CROSSING**

DRAWN BY: DJH	SCALE: NTS	DATE: NOVEMBER 15, 1996	DWG. NO.: W&S-3
---------------	------------	-------------------------	-----------------