


NOTES

1. DIRECTION AND LENGTH OF D.I. PIPE TO BE FIELD COORDINATED.
2. BLOW-OFF VALVE PAY ITEM TO INCLUDE VALVE, VALVE BOX, BEND, CAP RIPRAP, AND UP TO 10 L.F. OF D.I. PIPE.
3. ADDITIONAL FITTINGS AND D.I. PIPE (OVER 10 L.F.) WILL BE PAID UNDER APPROPRIATE BID ITEM.

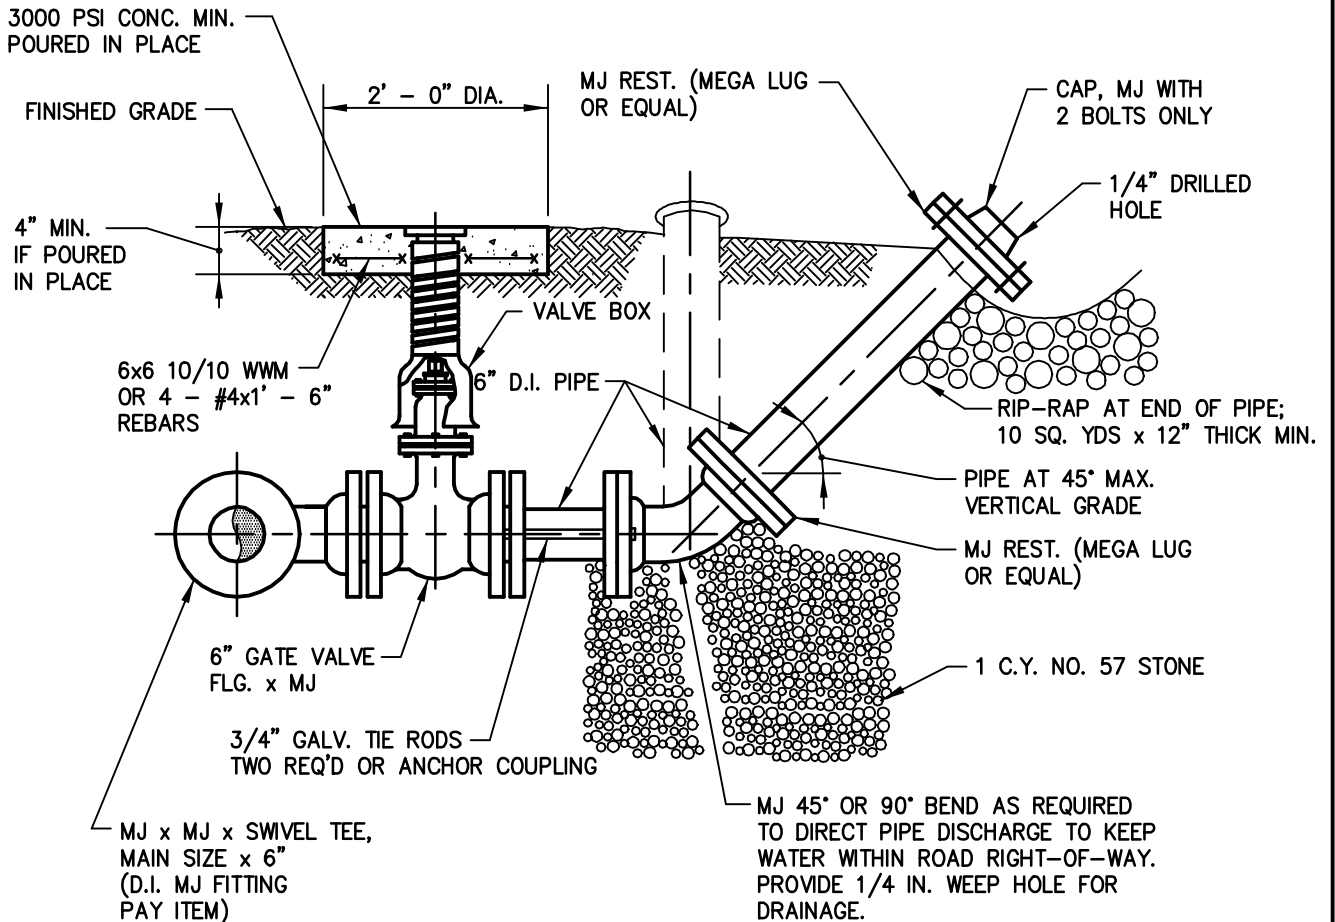

6" BLOW-OFF ASSEMBLY

NTS

BARTOW COUNTY, GEORGIA
 BARTOW COUNTY WATER SYSTEM
 TELEPHONE (770) 387-5170

WATER DETAILS
6" BLOW-OFF ASSEMBLY

DRAWN BY: DL

SCALE: NTS

DATE: DEC. 6, 2001

DWG. NO.: WAT-13