


**NOTES**

1. SEE SPECIFICATIONS FOR WATER SERVICE CONNECTIONS.
2. 3/4" GATE VALVE AND STUB-UP FOR NEW SUBDIVISION DEVELOPMENT ONLY.

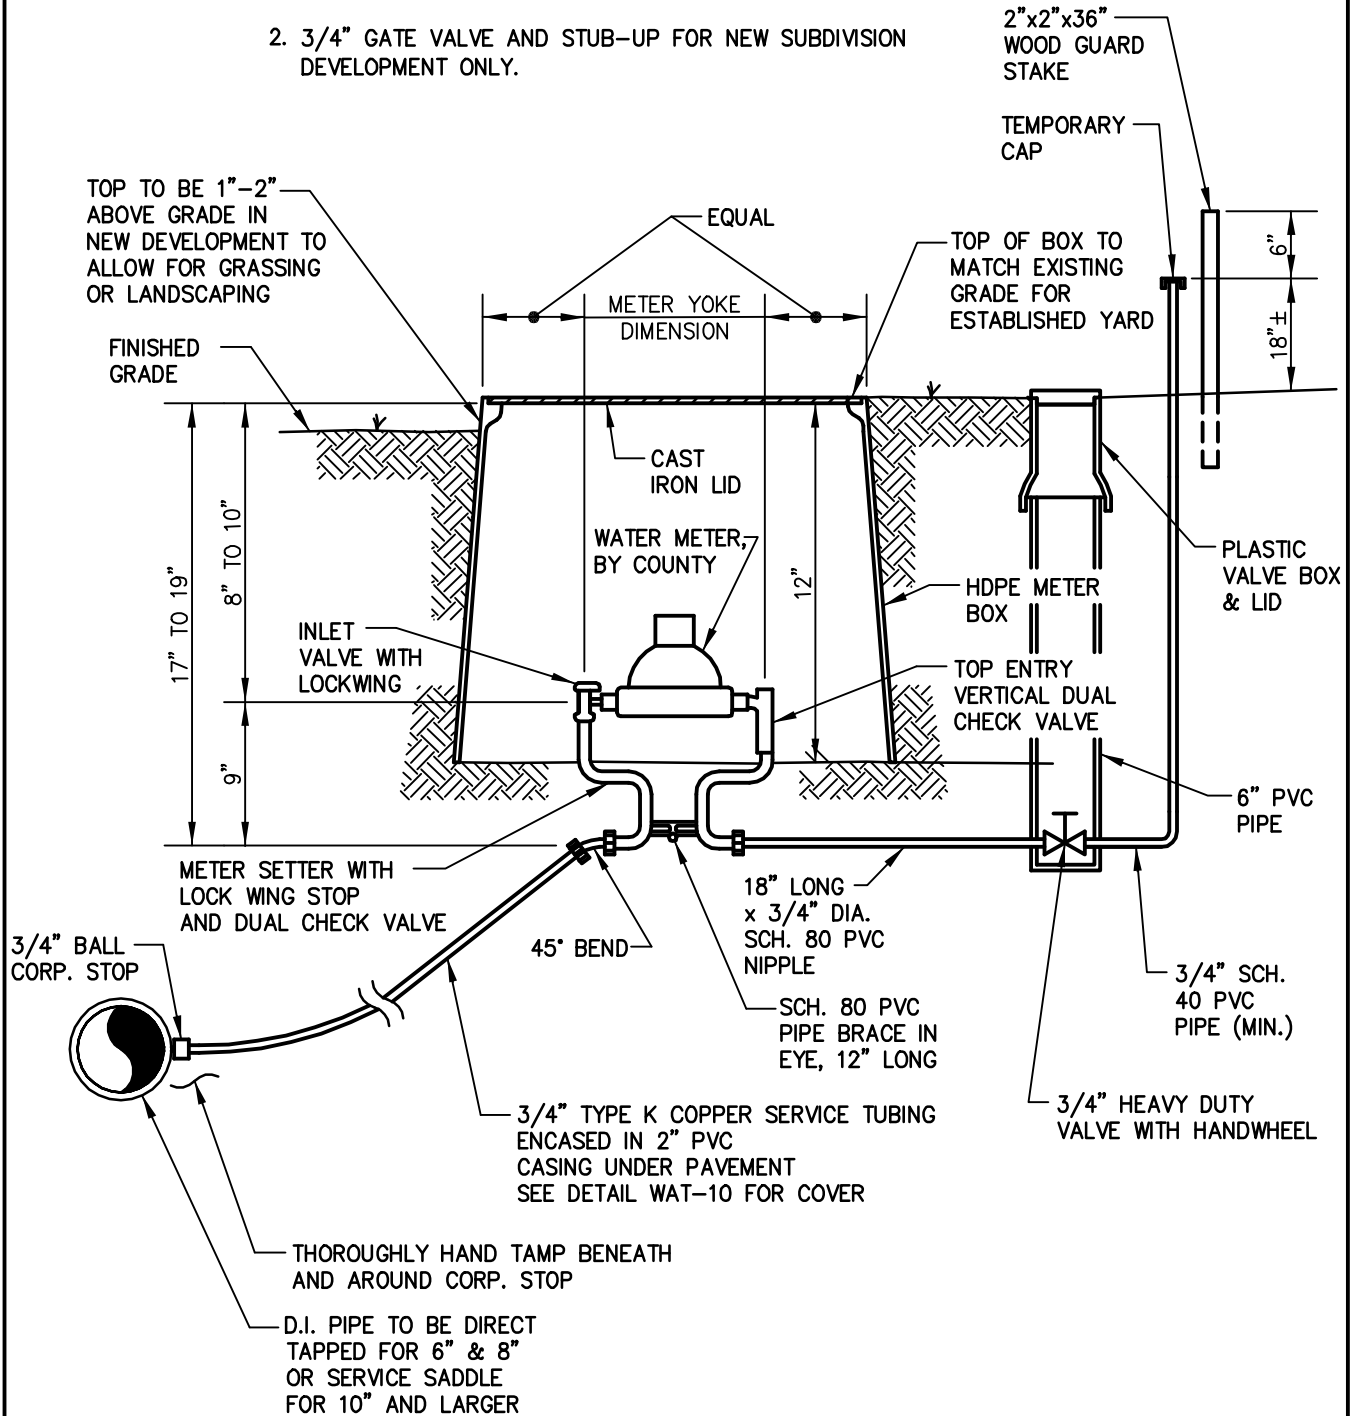

| 3   | 12/20/03 | DLJ | ADDED 3/4" VALVE AND STUB-UP |
|-----|----------|-----|------------------------------|
| 2   | 03/15/03 | ROE | REVISED LAYOUT DIMENSIONS    |
| 1   | 03/07/01 | DVK | ADDED CHECK VALVE            |
| NO. | DATE     | BY  | REVISION                     |

**BARTOW COUNTY, GEORGIA**  
 BARTOW COUNTY WATER SYSTEM  
 TELEPHONE (770) 387-5170

**WATER DETAILS**  
**3/4" x 5/8" SERVICE CONNECTION**