


NOTES

1. ALIGN FIRE HYDRANT WITH PROPERTY LINE. CONSTRUCT WITH MINIMUM DISTANCE OF 9' FROM BACK OF CURB TO BACK OF HYDRANT AND BACK OF CURB TO BACK OF CONCRETE BLOCKING.
2. NO M.J. FITTINGS UNDER PAVEMENT OR CURB AND GUTTER.

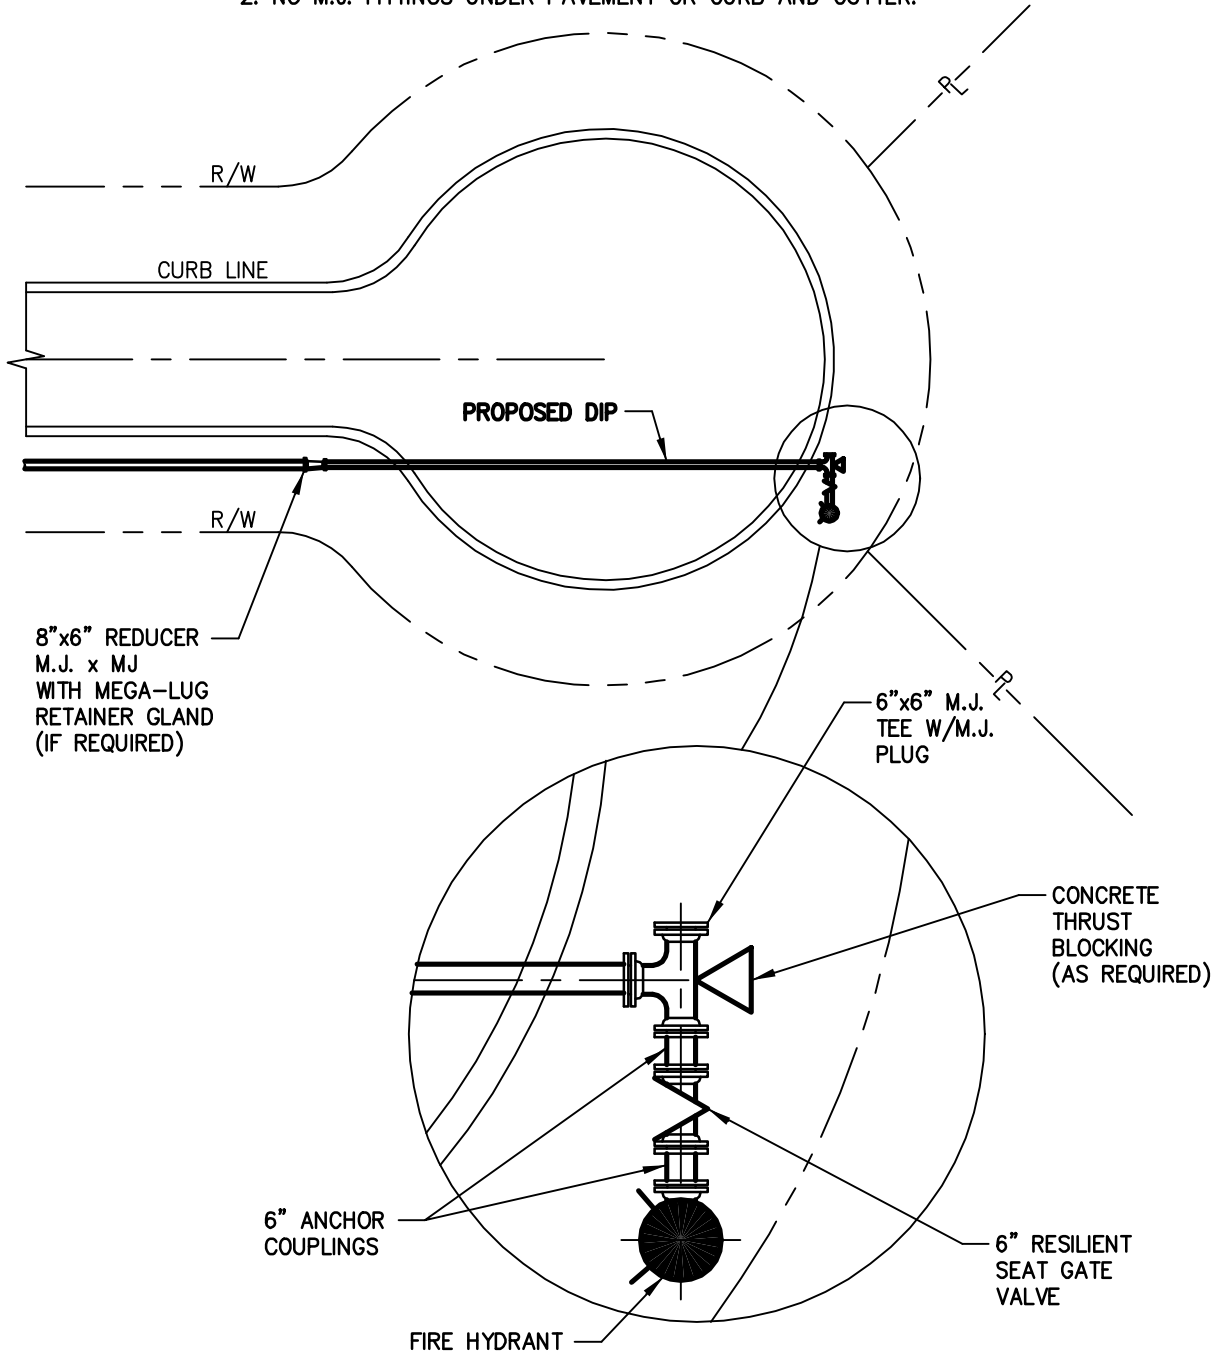

2	12/20/03	DLJ	REVISED NOTES
1	03/07/01	DVK	REVISED NOTES
NO.	DATE	BY	REVISION

BARTOW COUNTY, GEORGIA
 BARTOW COUNTY WATER SYSTEM
 TELEPHONE (770) 387-5170

**WATER DETAILS
 WATERMAIN AT CUL-DE-SAC**

DRAWN BY: DVK	SCALE: NTS	DATE: JULY 17, 1998	DWG. NO.: WAT-6
---------------	------------	---------------------	-----------------